


SHIFT


SLC
Scandinavian
Lighting Concept

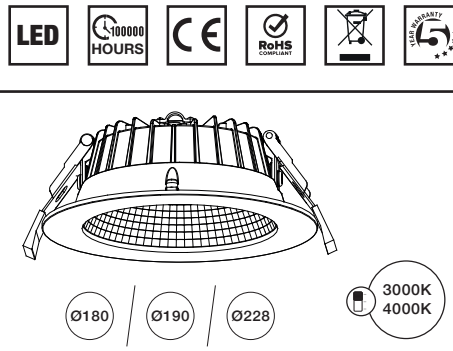

Pressure relief plate included

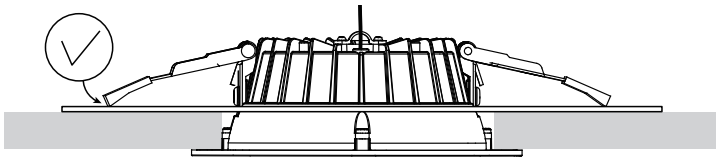


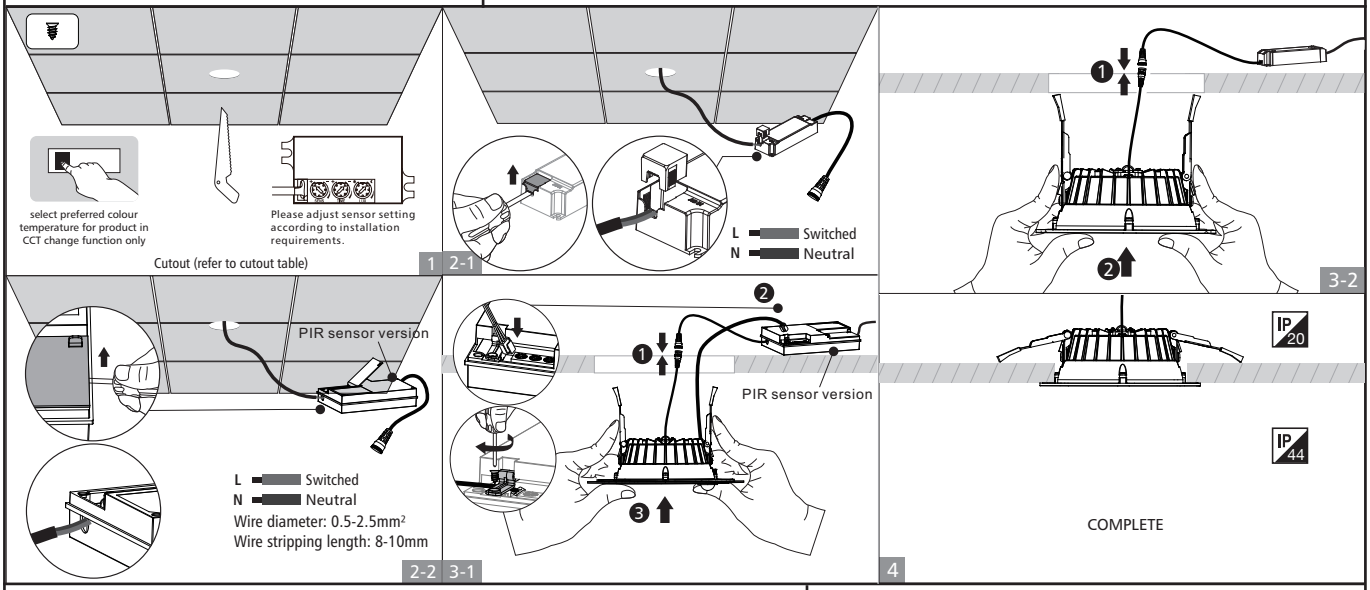

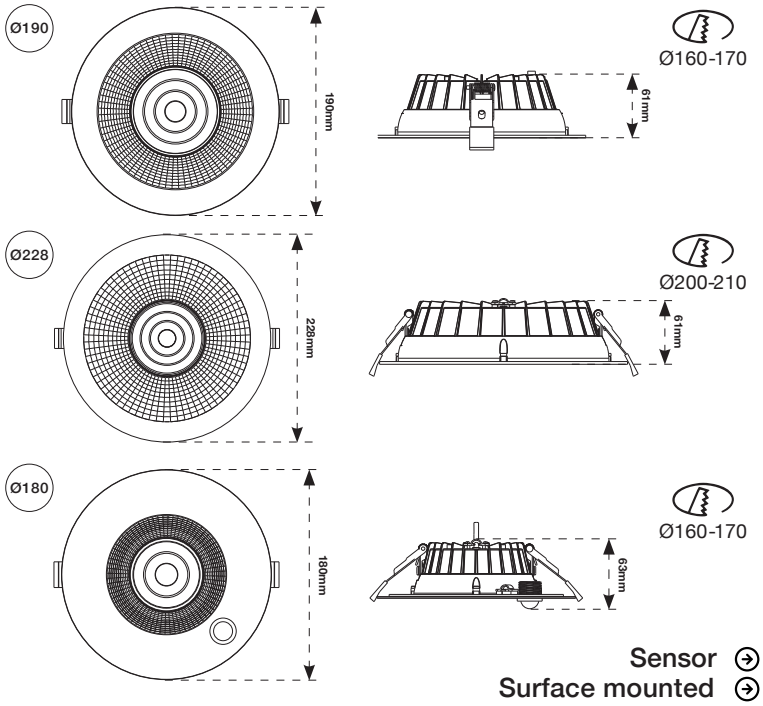

Sensor
Surface mounted

Installation Spacing



>10 cm³ Air

NO: Må installeres av godkjent installatør
EN: Only to be installed by an authorized electrician
DE: Nur von einer autorisierten Elektrofachkraft installierenlassen
FI: Asenna vain valtuutettu sähköasentaja
FR: Seulement pour être installé par un électricien autorisé
IS: Aðeins skal setja upp af viðurkenndum rafvirki
ES: Solo para ser instalado por un electricista autorizado.
IT: Solo per essere installato da un elettricista autorizzato

NO: Slå av strømmen før montering
EN: Power off before installing
DE: Schalten Sie vor der Installation die Stromversorgung aus
FI: Katkaise virta ennen asennusta
FR: Couper le courant avant d'installer
IS: Slökktu á orku áður en þú setur upp
ES: Apague la alimentación antes de instalar
IT: Spegnere l'alimentazione prima di installare

THE LIGHT GROUP AS | Tlf.: +47 38 00 21 01 | E-Mail: post@tlg.no
Mjavannsvegen 175 | 4628 | Kristiansand S | Norway


THE LIGHT GROUP GmbH | Phone: +49 511 807 486 10 | E-Mail: info@tlg.no
Am Schafbrinke 62 | 30519 | Hannover | Germany


rev.21.03.23

SHIFT

SLC
Scandinavian
Lighting Concept

Surface mounted

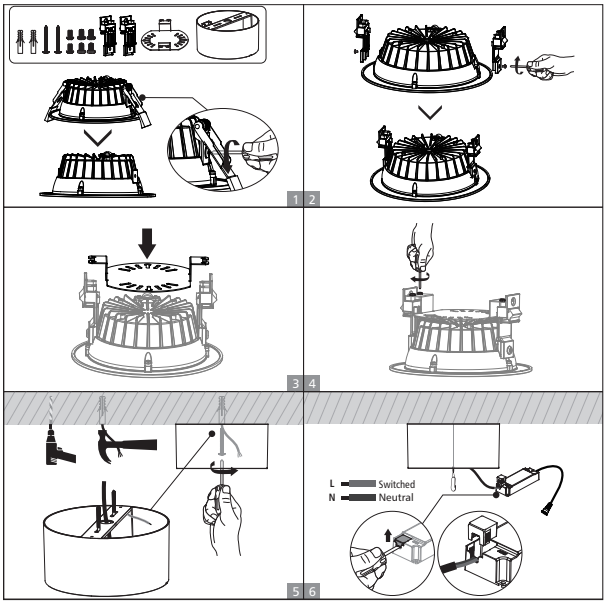

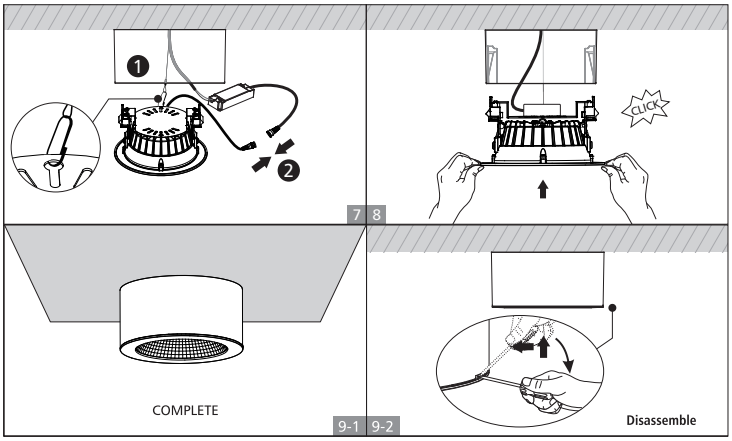


PIR Sensor


Sensor datasheet

Operating voltage	AC220-240V
Power consumption	1W max
Microwave frequency	–
Transmission power	–
Detection angle	90°
Detection Area	2-3M Knob adjustable
Hold time	10S-7min Knob adjustable
Daylight sensor	10-2000lux Knob adjustable
Stand-by DIM Level	–
Stand-by Period	–
Dimming Range	–
Microwave ON/OFF function	–
Installation Height	Recessed recommended height is 2.5m
Minimum mounting distance	recommended mounting distance should be more than 2m
Operating temperature(℃)	-20℃~40℃


Wiering diagram

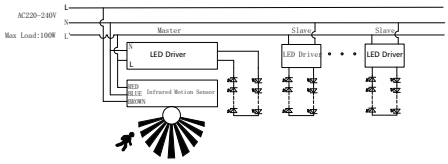


Detection range diagram

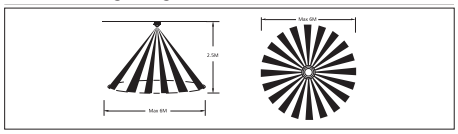

Settings



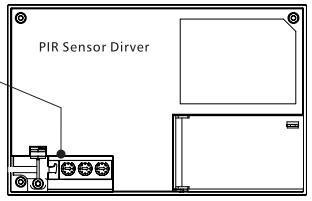

Factory settings		
Detection Area	Hold Time	Daylight Sensor
100%	10S	10lux



Detection area:

The detection area can be adjusted by the knob, clockwise adjustment increases the sensitivity, counterclockwise adjustment reduces the sensitivity, the maximum detection distance is 6 meters, the minimum detection distance is 2 meters.
Notice 1:The distance test is carried out under Ta25°C, 1.8 meters wall mounting installation height. The test result is based on the movement along the tangential direction of the sensor, and the detect distance can be adjusted by the dial switch.
Notice 2:Infrared sensor will be affected by temperature. Too high or too low temperature may affect the detect distance or even cause failure to sensor.



Hold time:

The hold time can be adjusted by the knob. Clockwise adjustment increases the hold time, counterclockwise adjustment reduces the hold time, the maximum hold time is 7min, and the minimum hold time is 10S.
Notice 1:The hold time counting should be started after the sensor is powered on and initialized.



Daylight sensor:

The light threshold can be selected through the Knob. Clockwise adjustment increases the light threshold, counterclockwise adjustment reduces the light threshold, the maximum light threshold is 2000lux, and the minimum light threshold is 10lux.
Notice 1:The light threshold may cause a large deviation in different lamps.

THE LIGHT GROUP AS | Tlf.: +47 38 00 21 01 | E-Mail: post@tlg.no
Mjavannsvegen 175 | 4628 | Kristiansand S | Norway

THE LIGHT GROUP GmbH | Phone: +49 511 807 486 10 | E-Mail: info@tlg.no
Am Schafbrinke 62 | 30519 | Hannover | Germany

rev.21.03.23